


**Hose Load**  
 1:150ft of 3" Pre-Connected  
 2:200ft of 2.5"  
 3:1500ft of 5"  
 4:250ft of 3"  
 5:200ft of 1.75"

Left Side Compartmentation				
Compt	Doors	Opening Dimensions	Inside Dimensions	Volume
WxHxD				
L1	Roll Up	33x61	40x71x24.25	39.9 CU FT
L2	Roll Up	53x30	60x40x24.25	33.7 CU FT
L3	Roll Up	43x61	50x71x24.25	49.8 CU FT
Right Side Compartmentation				
Compt	Doors	Opening Dimensions	Inside Dimensions	Volume
R1	Roll Up	33x61	40x71x24.25	39.9 CU FT
R2	Roll Up	53x30	60x40x24.25	33.7 CU FT
R3	Roll Up	43x61	50x71x24.25	49.8 CU FT
Rear Compartmentation				
Compt	Doors	Opening Dimensions	Inside Dimensions	Volume
A1	Hinged	44x20	48x25x22.25	17.3 CU FT
Right Side Compartmentation				
Compt	Doors	Opening Dimensions	Inside Dimensions	Volume
LH	Hatch	(2) 64.5x8.5	150x25x12.5	27.1 CU FT
RH	Hatch	(2) 64.5x8.5	150x25x12.5	27.1 CU FT

Hale Qmax 2000 single stage  
 Water Tank Capacity 750 gal  
 Foam Tank Capacity 25/25 gal  
 Total Volume 318.3 CU FT

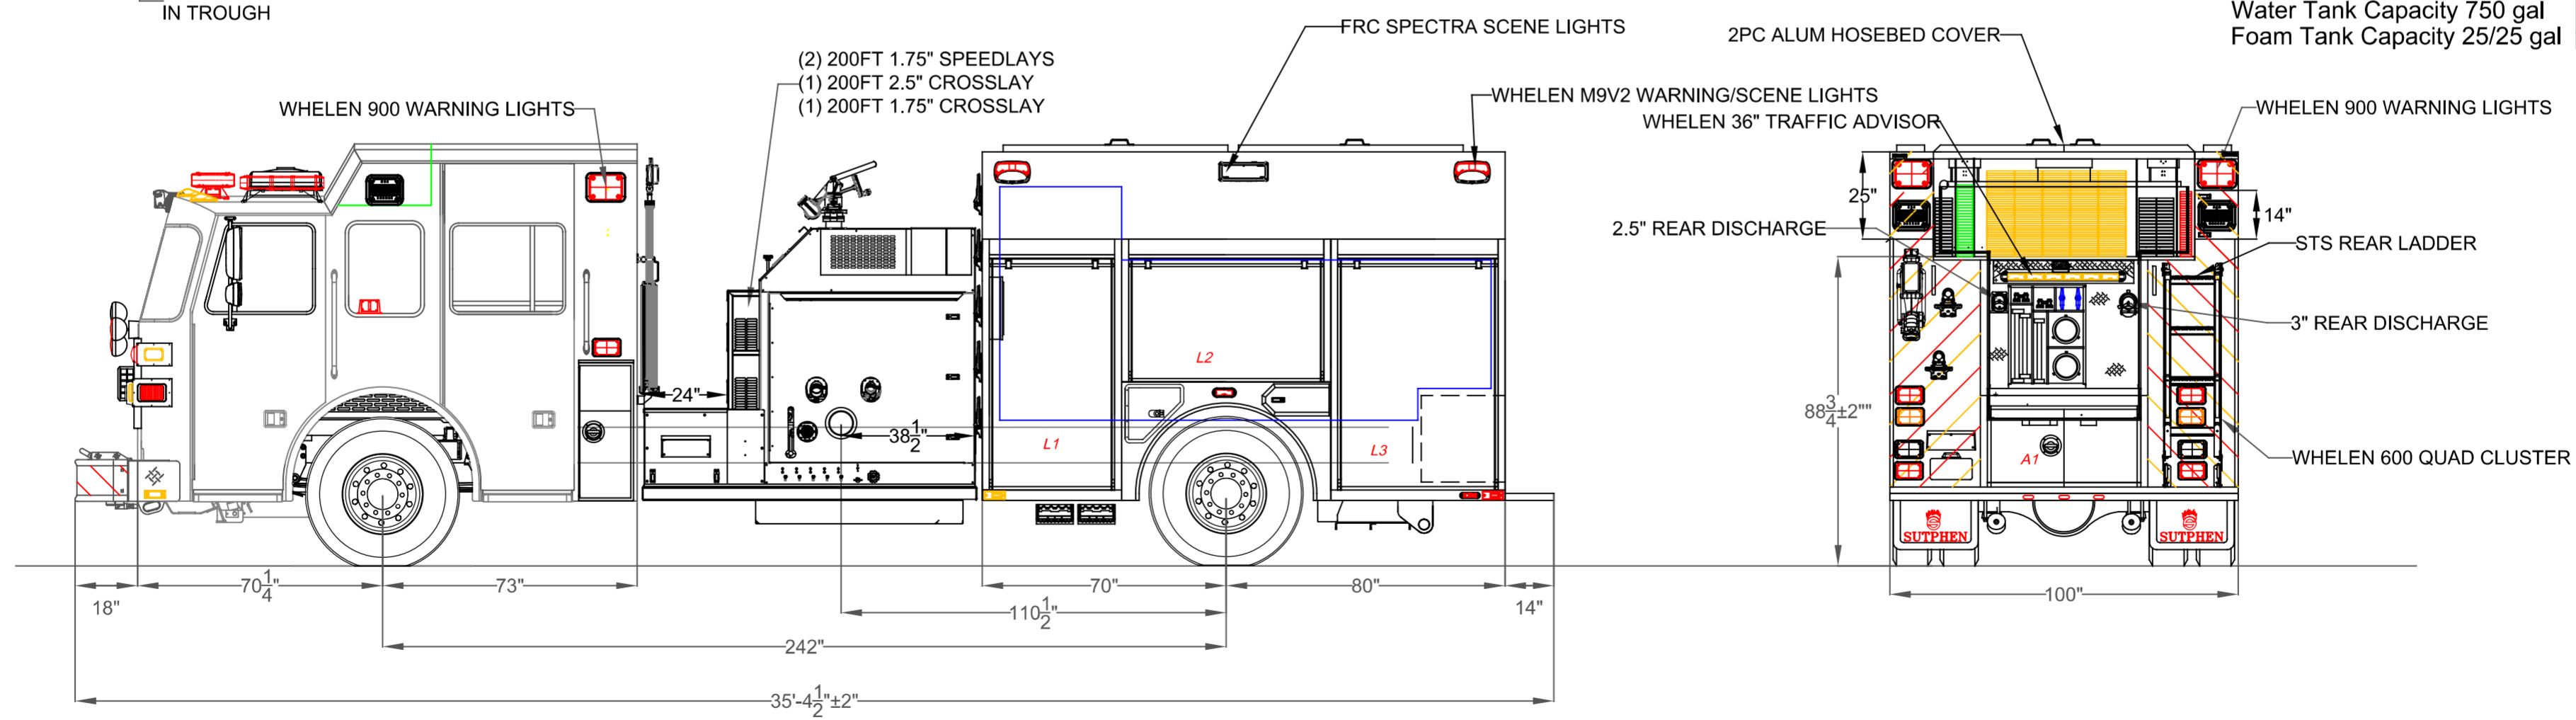

DIMENSIONS SHOWN ON THIS DRAWING ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS DURING CONSTRUCTION.	CUSTOMER APPROVAL		D/E/F	CHANGE UPPER PANEL 2, 3 AND CAMERA MONITOR LOCATION, GRAPHICS APPROVAL/TOOL MOUNTING	SED	12/06/23	DRAWN BY:	S.DORFMAN	SUTPHEN EAST 55 INNOVATION DRIVE LAKE ARIEL, PA 1-844-776-2889
	IN THE EVENT OF A DISCREPANCY BETWEEN THE SUTPHEN SPECIFICATIONS AND DRAWING, THE SUTPHEN SPECIFICATIONS SHALL PREVAIL.	NAME:	C	CHANGE MODULE LENGTH AND LADDER TUNNEL DIMENSIONS	SED	2/1/23	DATE:		
DRAWING IS FOR REFERENCE ONLY. SOME ITEMS PROPOSED MAY NOT BE SHOWN OR NOTED.	TITLE:	B	CHANGE 3 VALVES TO ELECTRIC ACTUATORS	SED	11/7/22	MFG. FACILITY:	SUTPHEN EAST LAKE ARIEL, PA	YOUNGSTOWN WHITNEY VOL. FIRE DEPT. YOUNGSTOWN, PA	
	DATE:	A	PRE-CON	SED	5/24/22	DWG. NO.:	HS 7453		
			REV.	DESCRIPTION	BY	DATE			
THIS PRINT IS PROVIDED ON A RESTRICTED BASIS AND IS NOT TO BE USED IN ANY WAY DETRIMENTAL TO THE INTEREST OF SUTPHEN CORPORATION.									